


RADIA™ PATHWAY BOLLARD

SURFACE MOUNT INSTALLATION INSTRUCTIONS

MOUNTING KIT (SOLD SEPARATELY)

7/32" hex bit and T27 torx bit for tamper-resistant bolts




TOOLS NEEDED



steel wire brush



pencil




hammer



3/16", 3/8" & 1/2" drill bits for concrete



1/4" punch



hammer drill




Loctite

STEP BY STEP FOR ALL SURFACE MOUNTED RADIA PATHWAY BOLLARDS


1

Ø1.00 Conduit Entry Location



2x holes for Anchor Bolts

2



3

Prepare the incoming power

- Before pouring concrete footer, run properly sized conduit and cabling to each luminary location according to local code requirements. Refer to figure above for dimensions for conduit entry envelope size and location on luminary.

Forms+Surfaces is not responsible for site preparation and footings.

Note: Conduit should not protrude more than 2" above mounting surface.

Mark hole locations

- Place base plate in desired location. Mark center of each hole location with a pencil.

Drill holes


- Use hammer drill to drill 1-7/8" deep x 1/2" diameter anchor hole at each marked location using a 1/2" drill bit suitable for concrete drilling.

NOTE: Forms+Surfaces recommends starting holes with 3/16" diameter drill bit followed by 3/8" and finally 1/2" for maximum accuracy.

RADIA™ PATHWAY BOLLARD


SURFACE MOUNT INSTALLATION INSTRUCTIONS

STEP BY STEP FOR ALL SURFACE MOUNTED RADIA PATHWAY BOLLARDS

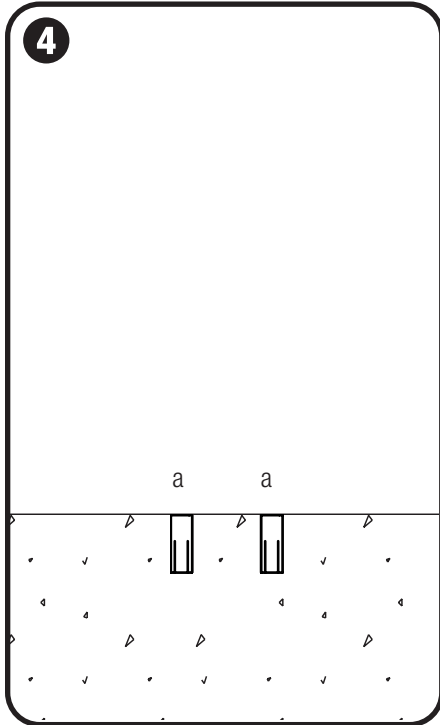


Fill holes & insert anchors

- Use compressed air and steel wire brush to clean each anchor hole.
- Insert 3/8"-16 x 1-1/2" anchors (a) into each anchor hole and use hammer to tap anchor tops flush with ground level.
- Use 1/4" punch and hammer to set anchors by driving down the center of each anchor until it stops.

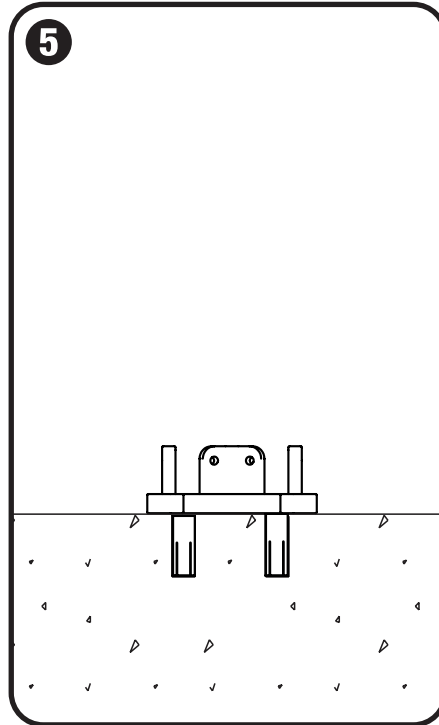

Position base plate

- Position base plate so that the mounting holes line up with anchors.

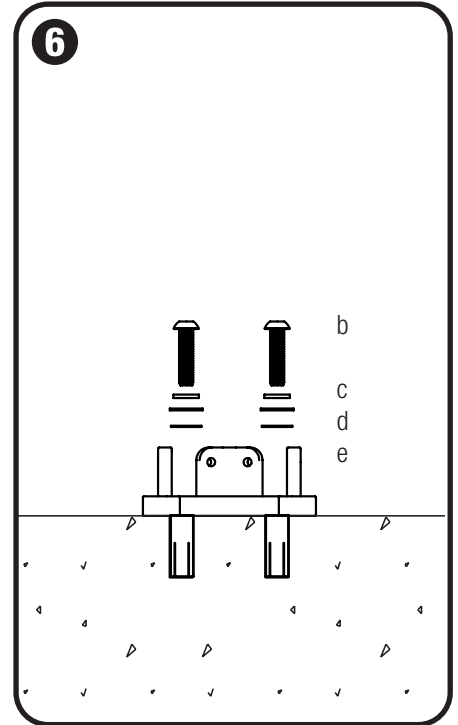


Attach base plate

- Slide 3/8" stainless steel lock washer (c), stainless steel flat washer (d) and polymer flat washer (e) onto each 3/8"-16 x 1-1/2" tamper-resistant button head cap bolt (b).
- Insert bolts into mounting holes in base plate and thread into anchors using 7/32" hex bit for tamper-resistant bolts.

RADIA™ PATHWAY BOLLARD

SURFACE MOUNT INSTALLATION INSTRUCTIONS

STEP BY STEP FOR ALL SURFACE MOUNTED RADIA PATHWAY BOLLARDS

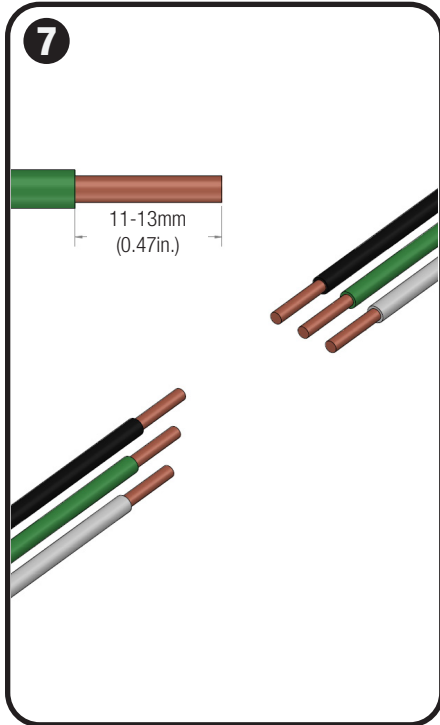


Locate and prepare wires

Note: Installation should be performed only by qualified individuals.

- Before proceeding with wiring of luminary, check to ensure that all applicable site wiring and safety codes have been followed.
- Locate wires at base of light fixture.
- Ensure power supply is shut off and circuit being used is isolated.
- Prepare wiring from site junction box and bollard by stripping and removing 11-13mm (.47") of insulation.

Note: Wire used should be 22-14 AWG copper conductors.


Caution: Installation of a surge protector as part of each unit's wiring is recommended.

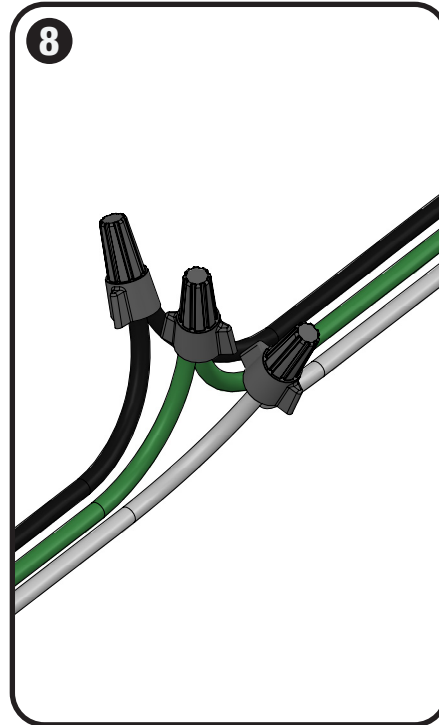

Connect wires

- Insert ground (green), neutral (white), and positive (black) wires into wire nuts, being sure to match wire color codes from junction box to bollard.
- Tighten wire nuts until exposed wire ends are below bottom of wire nut.
- Inspect all wiring and connections before use.

Caution: Light fixture rated for 120-277 VAC power.

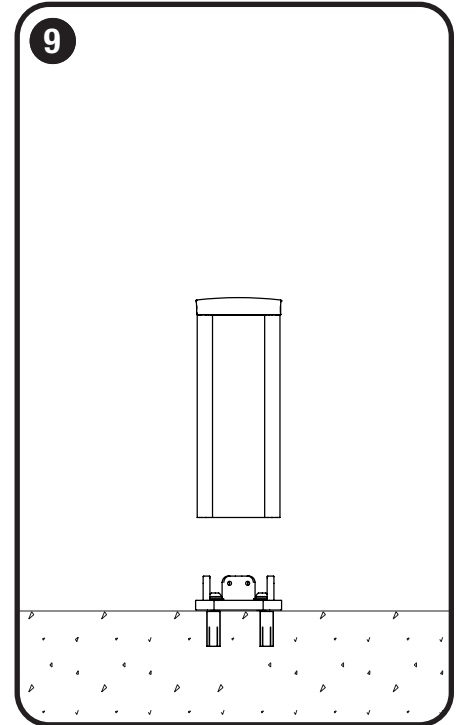


Place pathway bollard

- Slide pathway bollard over base plate, lower and align mounting holes.

RADIA™ PATHWAY BOLLARD

STEP BY STEP FOR ALL SURFACE MOUNTED RADIA PATHWAY BOLLARDS

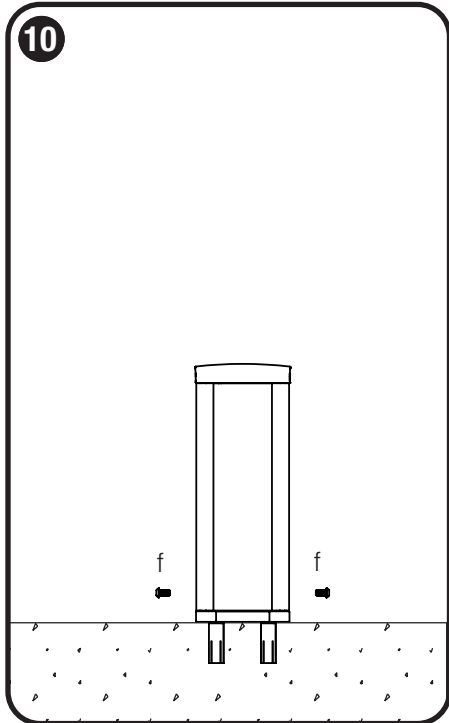

Attach bollard to base plate

- Thread 1/4"-28x1/2" tamper-resistant flat head bolts (f) into each hole.
- Use T27 torx bit for tamper-resistant bolts to tighten all bolts until snug.